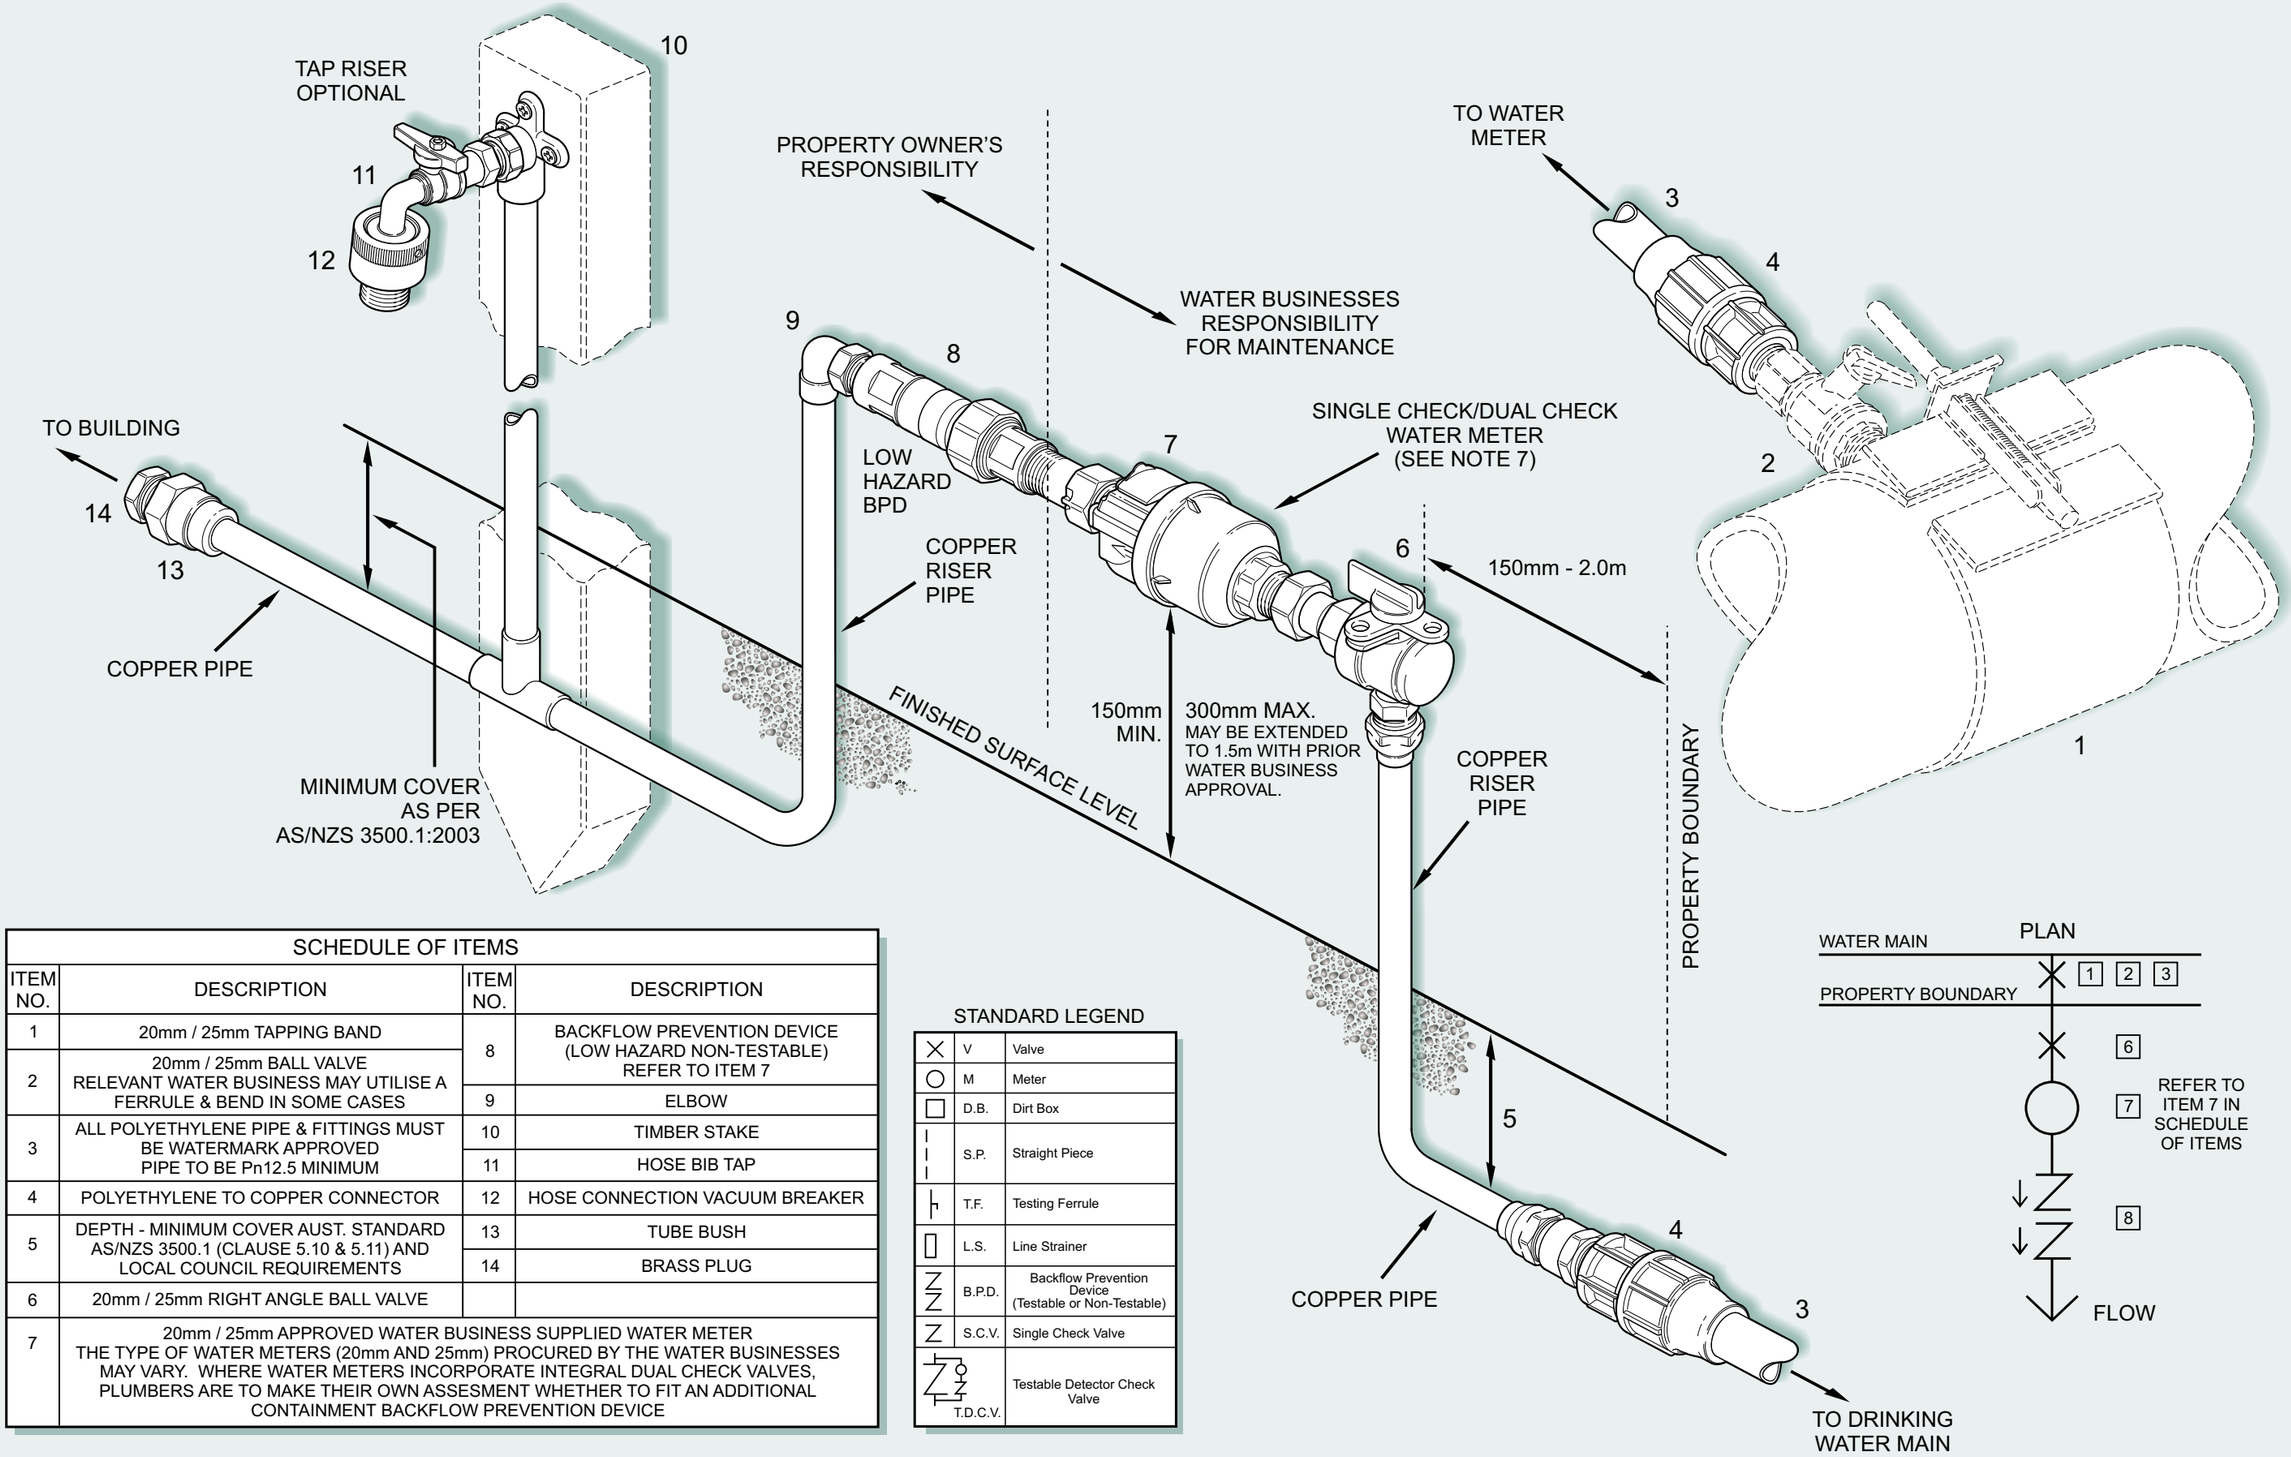

SCHEDULE OF ITEMS			
ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1	20mm / 25mm TAPPING BAND	8	BACKFLOW PREVENTION DEVICE (LOW HAZARD NON-TESTABLE) REFER TO ITEM 7
2	20mm / 25mm BALL VALVE RELEVANT WATER BUSINESS MAY UTILISE A FERRULE & BEND IN SOME CASES	9	ELBOW
3	ALL POLYETHYLENE PIPE & FITTINGS MUST BE WATERMARK APPROVED PIPE TO BE Pn12.5 MINIMUM	10	TIMBER STAKE
		11	HOSE BIB TAP
4	POLYETHYLENE TO COPPER CONNECTOR	12	HOSE CONNECTION VACUUM BREAKER
5	DEPTH - MINIMUM COVER AUST. STANDARD AS/NZS 3500.1 (CLAUSE 5.10 & 5.11) AND LOCAL COUNCIL REQUIREMENTS	13	TUBE BUSH
		14	BRASS PLUG
6	20mm / 25mm RIGHT ANGLE BALL VALVE		
7	20mm / 25mm APPROVED WATER BUSINESS SUPPLIED WATER METER THE TYPE OF WATER METERS (20mm AND 25mm) PROCURED BY THE WATER BUSINESSES MAY VARY. WHERE WATER METERS INCORPORATE INTEGRAL DUAL CHECK VALVES, PLUMBERS ARE TO MAKE THEIR OWN ASSESMENT WHETHER TO FIT AN ADDITIONAL CONTAINMENT BACKFLOW PREVENTION DEVICE		

STANDARD LEGEND

	V	Valve
	M	Meter
	D.B.	Dirt Box
	S.P.	Straight Piece
	T.F.	Testing Ferrule
	L.S.	Line Strainer
	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
	S.C.V.	Single Check Valve
	T.D.C.V.	Testable Detector Check Valve

DRAWING NUMBER:	SCALE:	DATE:	
1	NOT TO SCALE	JANUARY 2012	20 - 25mm GENERAL WATER SERVICE (WET TAPPING) LOW HAZARD RESIDENTIAL / COMMERCIAL / INDUSTRIAL TYPICAL ARRANGEMENT

City West Water | South East Water | Yarra Valley Water