


**TESTING FERRULES ARE NOT TO BE USED AS A WATER SUPPLY POINT - TEMPORARY OR PERMANENT**

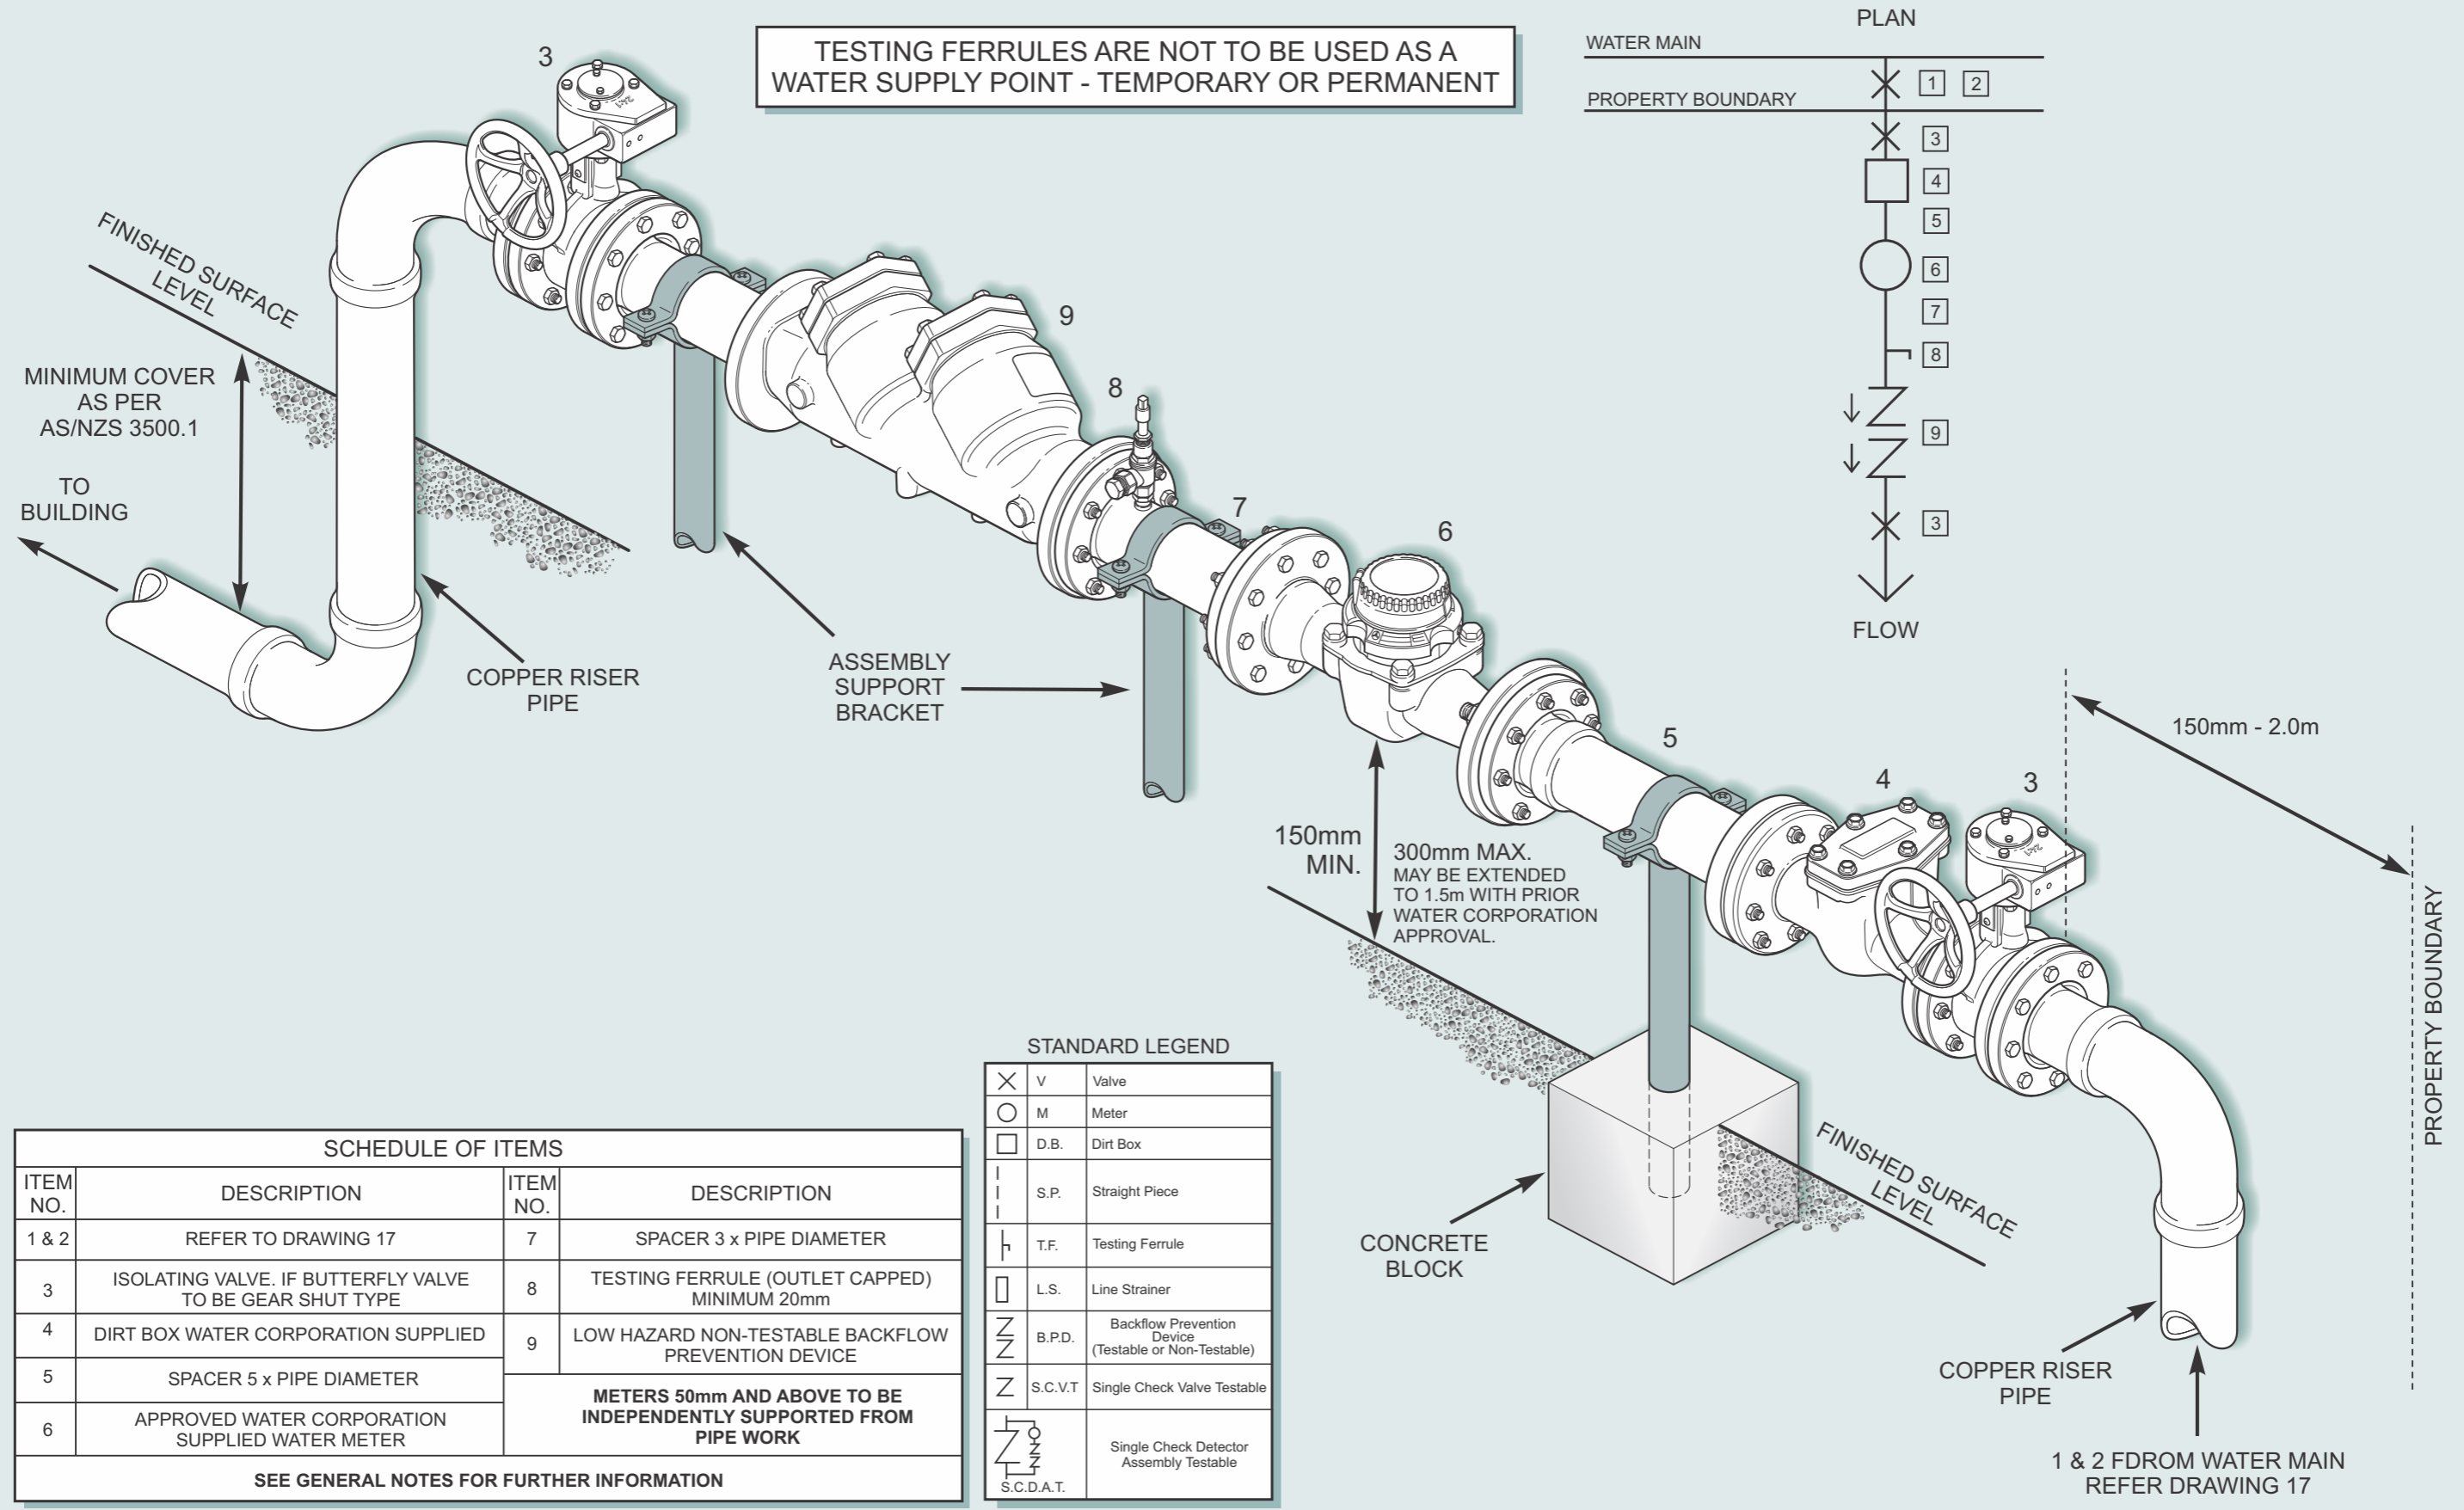

SCHEDULE OF ITEMS			
ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17	7	SPACER 3 x PIPE DIAMETER
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE	8	TESTING FERRULE (OUTLET CAPPED) MINIMUM 20mm
4	DIRT BOX WATER CORPORATION SUPPLIED	9	LOW HAZARD NON-TESTABLE BACKFLOW PREVENTION DEVICE
5	SPACER 5 x PIPE DIAMETER	<b>METERS 50mm AND ABOVE TO BE INDEPENDENTLY SUPPORTED FROM PIPE WORK</b>	
6	APPROVED WATER CORPORATION SUPPLIED WATER METER		
SEE GENERAL NOTES FOR FURTHER INFORMATION			

STANDARD LEGEND		
⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
⊥	T.F.	Testing Ferrule
□	L.S.	Line Strainer
∩	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
∩	S.C.V.T	Single Check Valve Testable
∩	S.C.D.A.T.	Single Check Detector Assembly Testable