


FOR THE USE OF INLINE WATER METERS REFER TO METERING GUIDELINES, CLAUSE 10.3

TESTING FERRULES ARE NOT TO BE USED AS A WATER SUPPLY POINT - TEMPORARY OR PERMANENT

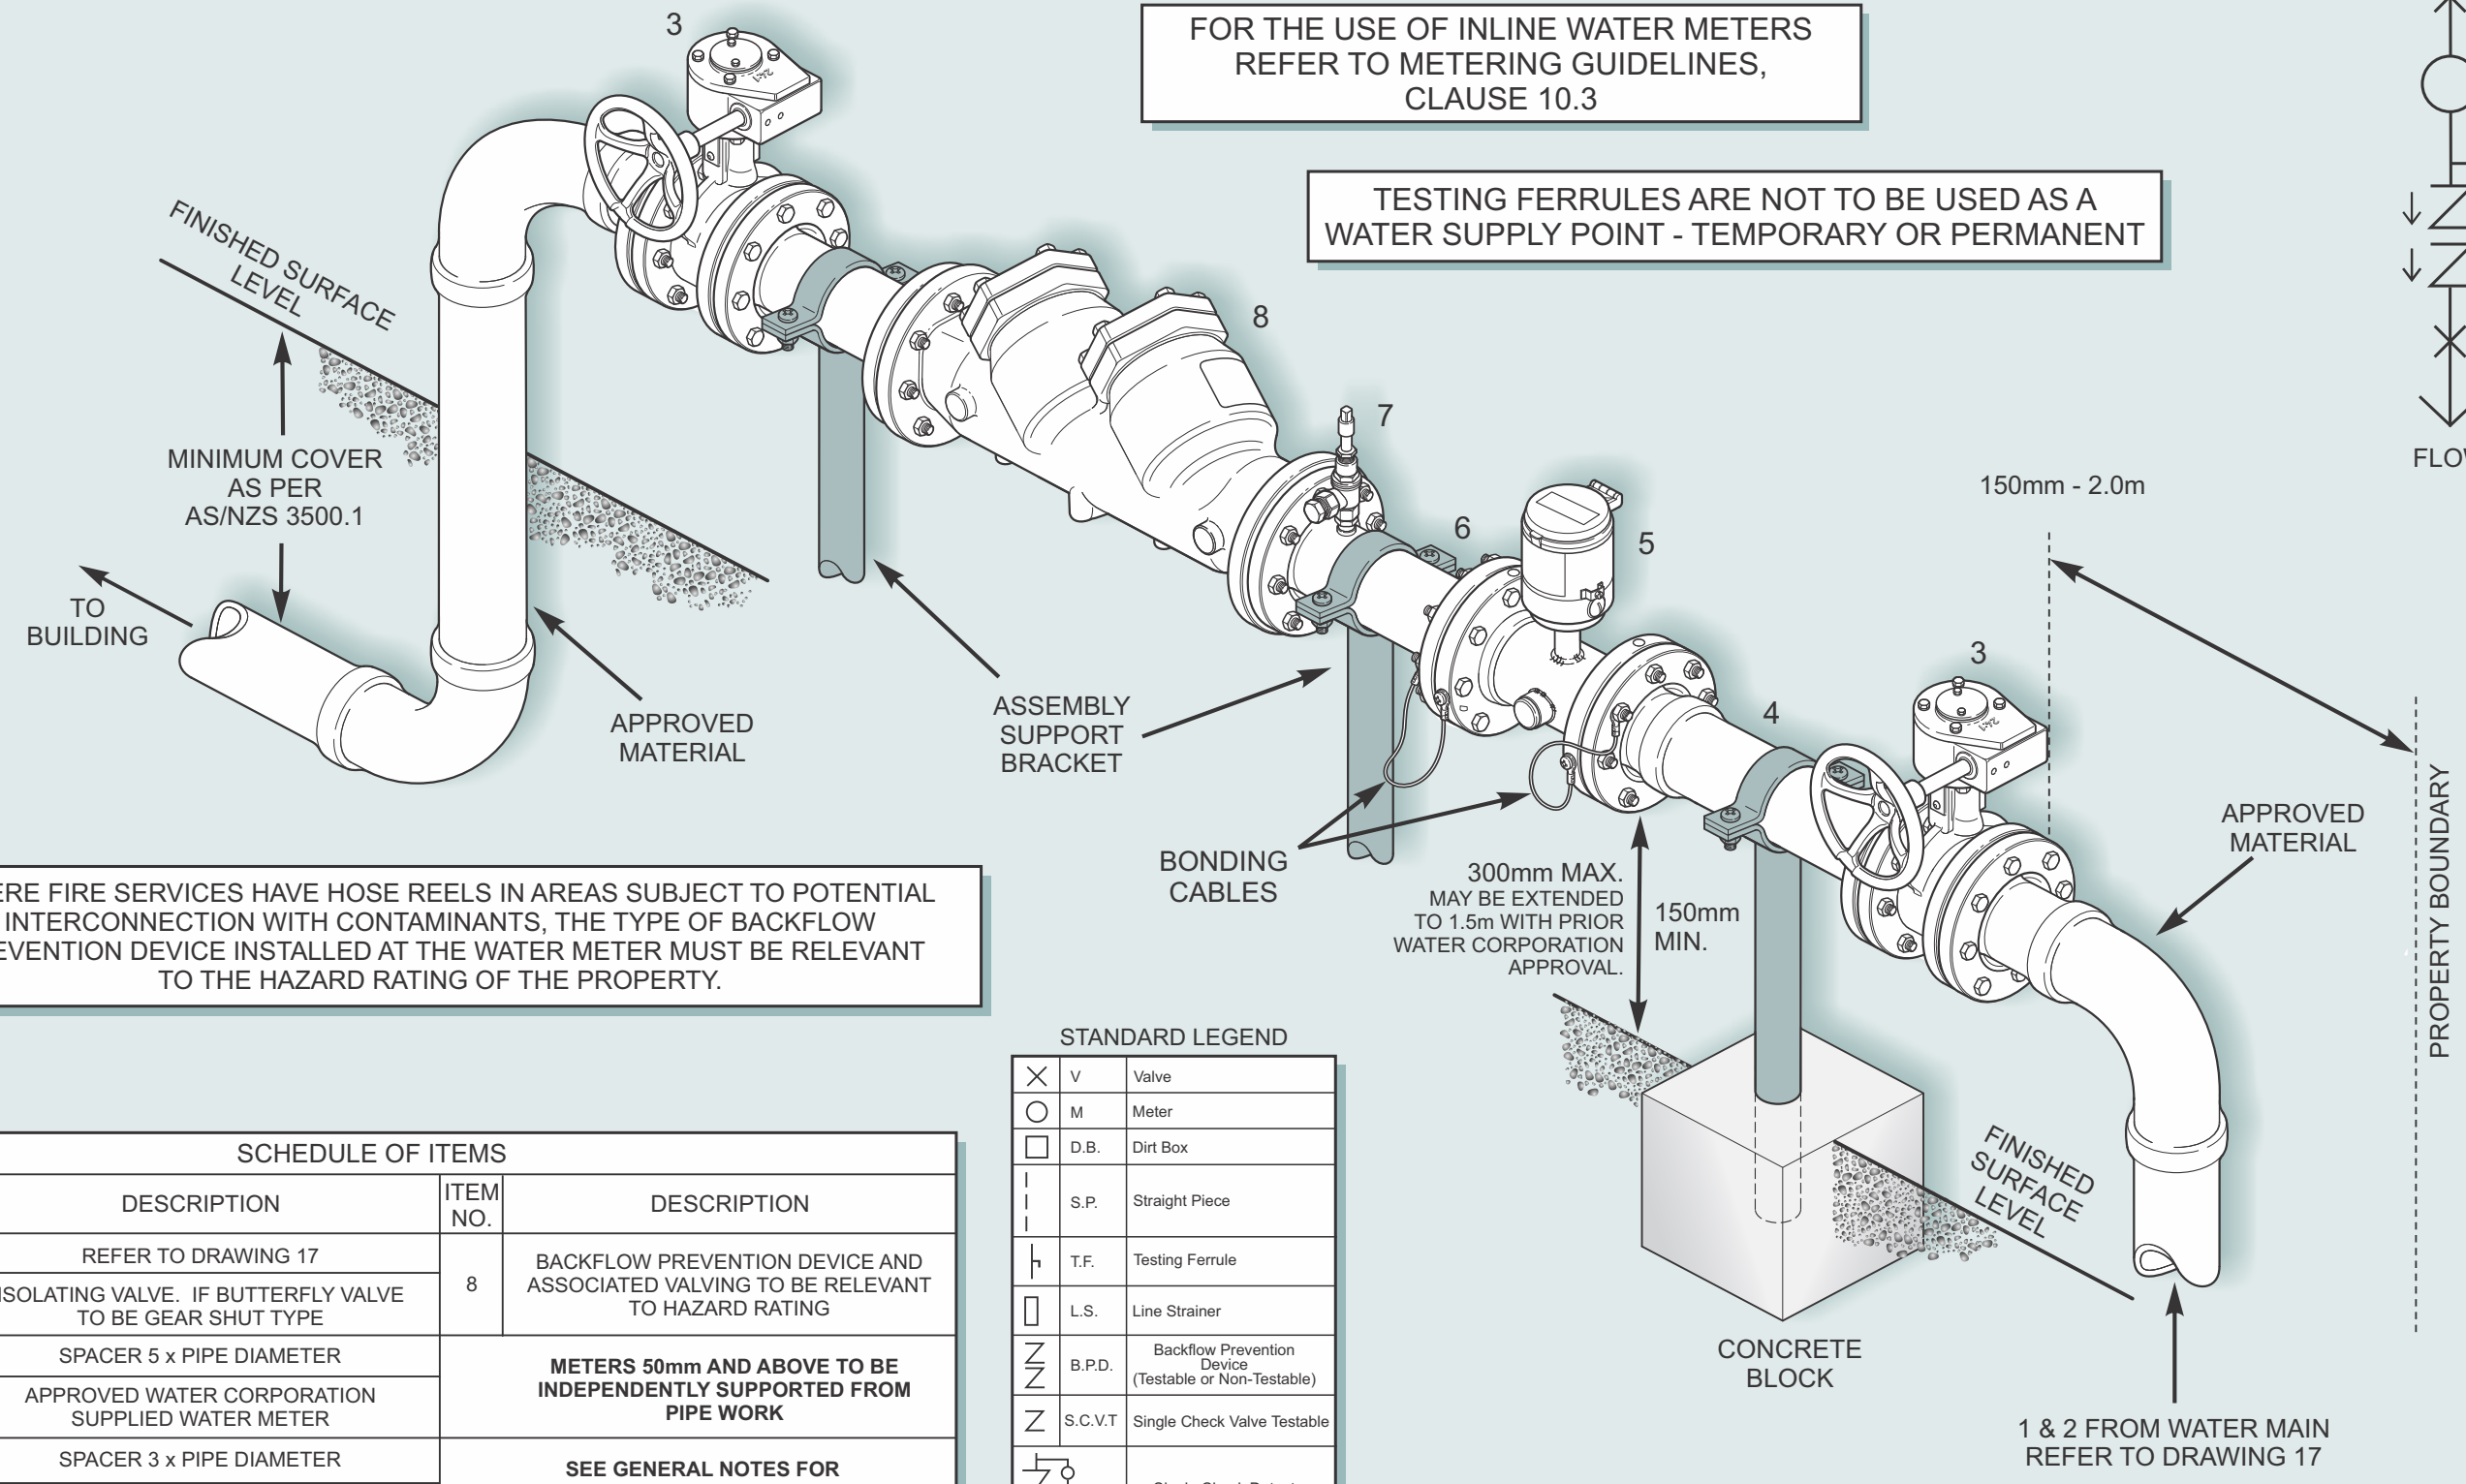

WHERE FIRE SERVICES HAVE HOSE REELS IN AREAS SUBJECT TO POTENTIAL INTERCONNECTION WITH CONTAMINANTS, THE TYPE OF BACKFLOW PREVENTION DEVICE INSTALLED AT THE WATER METER MUST BE RELEVANT TO THE HAZARD RATING OF THE PROPERTY.

STANDARD LEGEND

⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
⊥	T.F.	Testing Ferrule
□	L.S.	Line Strainer
∩	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
∩	S.C.V.T.	Single Check Valve Testable
∩	S.C.D.A.T.	Single Check Detector Assembly Testable

SCHEDULE OF ITEMS

ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17	8	BACKFLOW PREVENTION DEVICE AND ASSOCIATED VALVING TO BE RELEVANT TO HAZARD RATING
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE		
4	SPACER 5 x PIPE DIAMETER	<b>METERS 50mm AND ABOVE TO BE INDEPENDENTLY SUPPORTED FROM PIPE WORK</b>	
5	APPROVED WATER CORPORATION SUPPLIED WATER METER		
6	SPACER 3 x PIPE DIAMETER		
7	TESTING FERRULE (OUTLET CAPPED) MINIMUM 20mm	<b>SEE GENERAL NOTES FOR FURTHER INFORMATION</b>	